



# VGS Oily Water Separator Stand Mounted

# A4

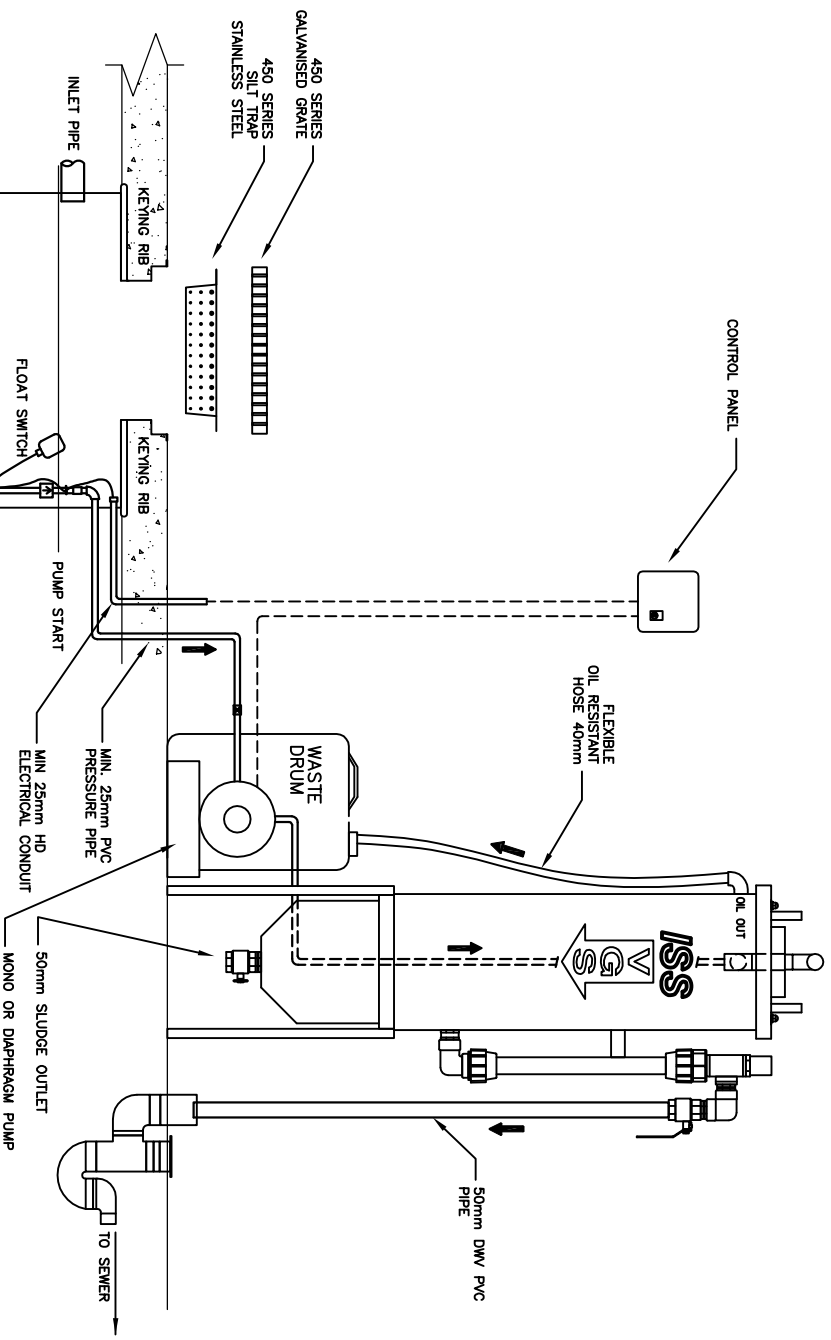

- NOTES**
1. TO BE INSTALLED IN ACCORDANCE WITH LOCAL WATER AUTHORITY REQUIREMENTS
  2. SEPARATOR & PUMP TO BE SIZED TO MATCH PIT INFLOW
  3. STAND MOUNTED MODELS AVAILABLE AT FLOW RATES OF 1000-3000L/HR
  4. PIT AVAILABLE WITH GALVANISED GRATE OR GAS TIGHT GATIC LID
  5. PUMP SUCTION LINE TO BE PVC PRESSURE PIPE SIZED TO MATCH THE PUMP
  6. INSTALL CHECK VALVE IN SUCTION LINE ONLY WITH MONO PROGRESSIVE CAVITY PUMPS
  7. DO NOT INSTALL CHECK VALVE IN SUCTION FOR DIAPHRAGM PUMPS
  8. ENSURE SUCTION LINE FINISHES AT LEAST 200mm OFF THE BOTTOM OF THE PIT
  9. ENSURE PUMP STOP LEVEL IS 100mm ABOVE END OF THE SUCTION PIPE
  10. ENSURE PUMP START LEVEL IS BELOW INLET PIPE LEVEL

Itemref	Quantity	Title/Name, designation, material, dimension etc		Article No./Reference	
Designed by PE	Checked by DP	Approved by - date GW - 15/8/06	File name TYPVGSINSTAL	Date 15/8/06	Scale 1:25
 <p><b>INDUSTRIAL SEPARATION SYSTEMS</b> Unit 4 / 181 -187 Toren Point Road, TAREN POINT, NSW, 2229 Ph: (02) 9524 6654 Fax: (02) 9524 6685 Web: www.issproject.com.au</p>		<p><b>VGS OILY WATER SEPARATOR INSTALLATION WITH 750L FIBREGLASS PIT &amp; UG SEWER</b></p>			
ISS-VGS-010				Revision A	Sheet 1/1