



VGS Oily Water Separator Free Standing

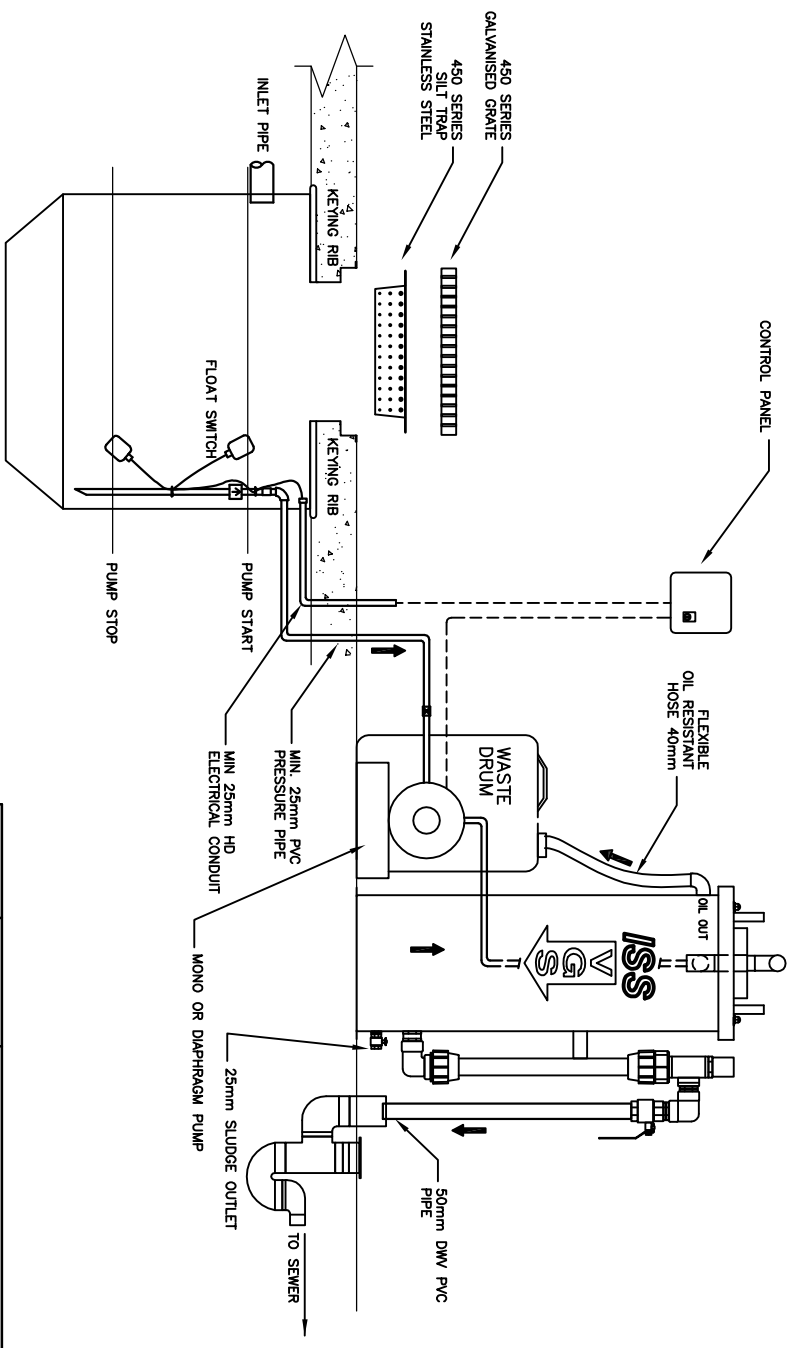

- NOTES**
1. TO BE INSTALLED IN ACCORDANCE WITH LOCAL WATER AUTHORITY REQUIREMENTS
 2. SEPARATOR & PUMP TO BE SIZED TO MATCH PIT INFLOW
 3. FREE STANDING MODELS AVAILABLE AT FLOW RATES OF 1000-1500L/HR
 4. PIT AVAILABLE WITH GALVANISED GRATE OR GAS TIGHT GATIC LID TO MATCH THE PUMP
 5. PUMP SUCTION LINE TO BE PVC PRESSURE PIPE SIZED PROGRESSIVE CAVITY PUMPS
 6. INSTALL CHECK VALVE IN SUCTION LINE ONLY WITH MONO PUMPS
 7. DO NOT INSTALL CHECK VALVE IN SUCTION FOR DIAPHRAGM PUMPS
 8. ENSURE SUCTION LINE FINISHES AT LEAST 200mm OFF THE BOTTOM OF THE PIT
 9. ENSURE PUMP STOP LEVEL IS 100mm ABOVE END OF THE SUCTION PIPE
 10. ENSURE PUMP START LEVEL IS BELOW INLET PIPE LEVEL

Itemref	Quantity	Title/Name, designation, material, dimension etc		Article No./Reference	
Designed by PE	Checked by DP	Approved by - date GW - 23/8/06	File name VXP0FP750INST123/8/06	Date 23/8/06	Scale 1:25
 <p>INDUSTRIAL SEPARATION SYSTEMS Unit 4 / 181 -187 Toren Point Road, TAREN POINT, NSW, 2229 Ph: (02) 9524 6654 Fax: (02) 9524 6685 Web: www.issproject.com.au</p>		<p>VGS OILY WATER SEPARATOR INSTALLATION WITH 750L FIBREGLASS PIT & UG SEWER</p>			
ISS-VGS-014		Revision A	Sheet 1/1		